

INDIVIDUAL SEWER SYSTEM INSPECTION REPORT

Condon

Name of Owner: Mary Phillips

Legal Address: Rumble Creek Rd

In Letter: Berry Seaman
(Subdivision, Lot No., Street Address, etc.)

Water Supply: Private X Public _____

Description of System: New Replacement _____

Septic Tank Capacity: 1000 CONCRETE Drainfield Material: PVC


Septic Tank Material: 1 FT Drainfield Length: 150

Depth of Septic Tank: _____ Drainfield Depth: 18-24"

Other: _____

Soil Type: SILTY GRAVEL

Distance of Installation from:
Property Lines: Front _____ Back _____ Side _____
Wells _____ Canals _____ Lakes _____ Streams _____

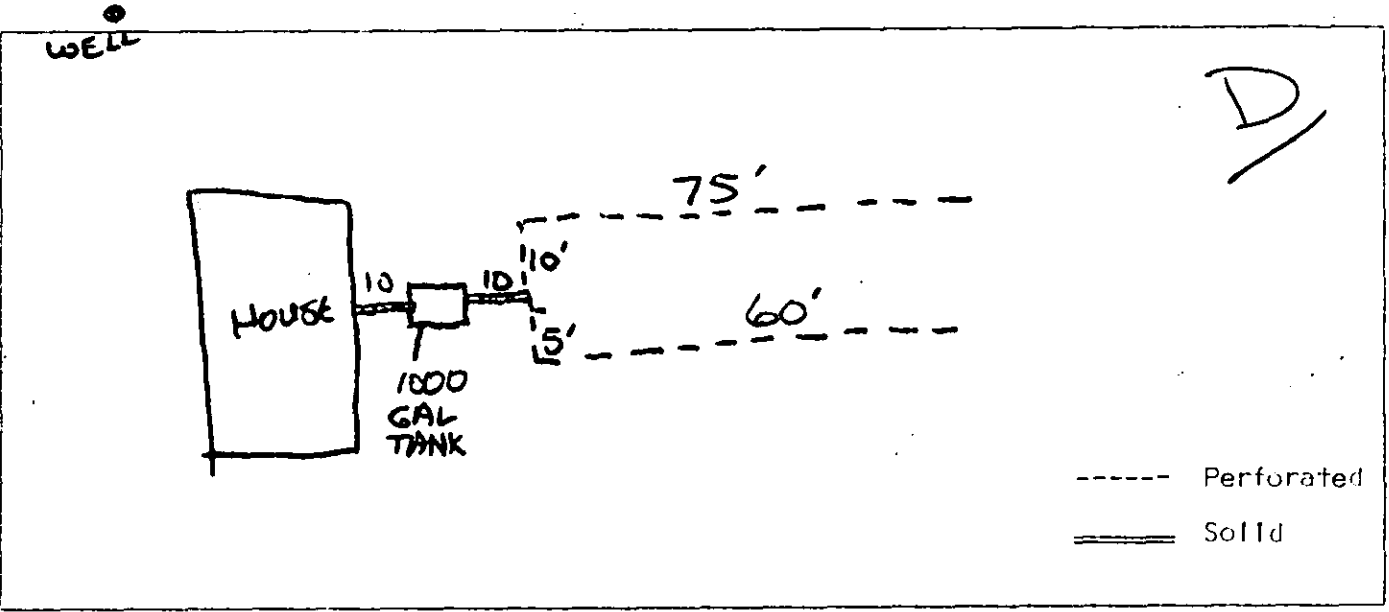

Installation Inspected:
 Disapproved
 Approved
Edward J. Zuleger Sanitarian
26 Aug 80 Date

Corrections Necessary: None

Inspection Witnessed By: Barbara Seaman
Date _____


79-402

General Information on Septic Tanks

Cleaning: Septic tanks should be cleaned before too much sludge or scum is allowed to accumulate. If either the sludge or scum approaches too closely to the bottom of the outlet device, particles will be scoured into the disposal field and will clog the system. When this occurs, it may be necessary to construct a new disposal system.

Tank Inspection: Tanks should be inspected at least once a year and cleaned when necessary. When a tank is inspected, the depth of sludge and scum should be measured in the vicinity of the outlet baffle. The tank should be cleaned if either: (1) The bottom of the scum mat is within approximately 3 inches of the bottom of the baffle; or (2) the top of sludge comes within 8 inches from the bottom of the baffle. (See diagram.)

Special Precautions: Toilet paper substitutes should not be flushed into a septic tank. Paper towels, newspaper, wrapping paper, rags, and sticks may not decompose in the tank, and are likely to lead to clogging of the plumbing and disposal system. Drainage from garage floors, or other sources of oily waste, should be excluded from the tank.

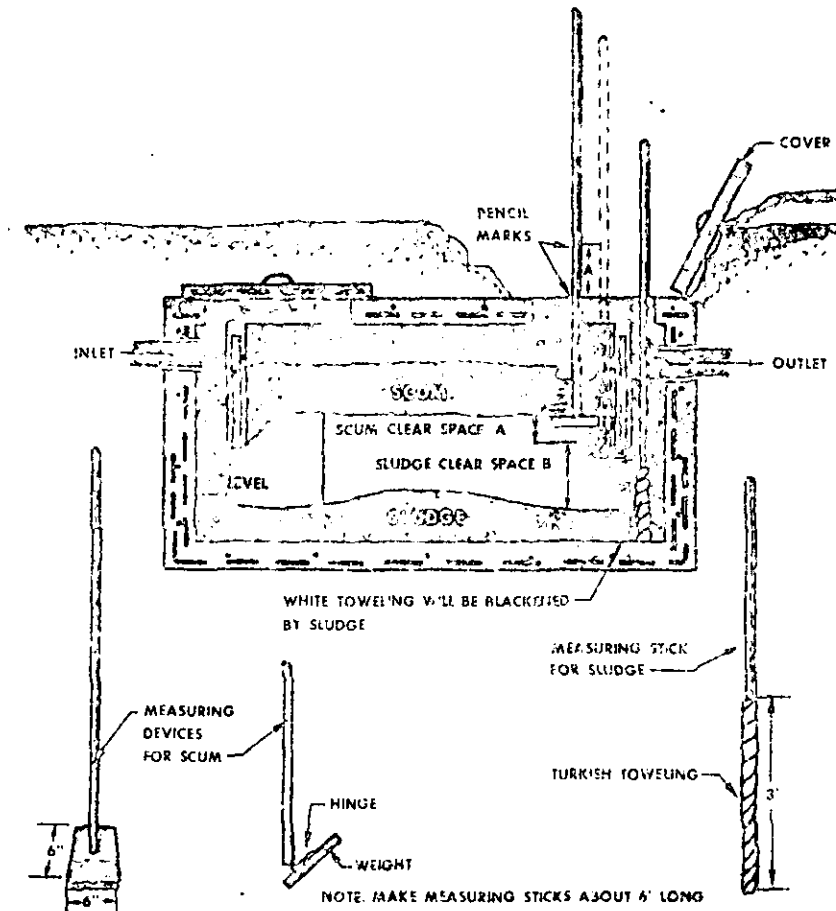

#79-462

APPLICATION FOR SEWER PERMIT

Name of Owner Mary Phillips Zoning Compliance Permit No. 002852

Name of Installer Barry Seamon

Location of Installation: (Property address, Subdivision, or Legal Description)
Rumble Creek (Gordon area) 48 ACRE PARCEL
T20N R16W S4 SE1/4

Residential: Number of Bedrooms 1 Sewage Flow, gal./day _____

Depth to Groundwater _____ Water Supply: Private _____

Soil Type SILTY GRAVEL Municipal _____

Percolation Rate 10 min/inch

Type of System to be Installed: New Replacement _____

Brief Description 1000 GAL TANK AND 150 FT OF DRAINFIELD

Special Conditions _____

Applicant's Signature _____ Date _____

Plans Disapproved _____ Date _____

Plans Approved _____ Date _____

The above is not a permit. It is an approval for which a permit must be obtained within 12 months of the approval date, or the approval is no longer valid. The permit must be obtained prior to beginning of construction.

PERMIT TO INSTALL AN INDIVIDUAL SEWER SYSTEM Permit Fee 65.00

As purchaser of this permit, I agree to install an individual sewer system which meets all requirements as specified in the Missoula County rules and regulations for subsurface sewage disposal systems.

Permit Purchaser Mary Phillips Date _____

Health Authority Edward Szulogez Date 13 Sept 79

This permit is valid for 12 months. Construction of the sewage disposal system must commence during this time or the permit is no longer valid. A final inspection by the Department is required prior to covering the installed system. Applicant's copy of the permit must be on-site at the time of inspection.