




NOT TO SCALE

LAYOUT

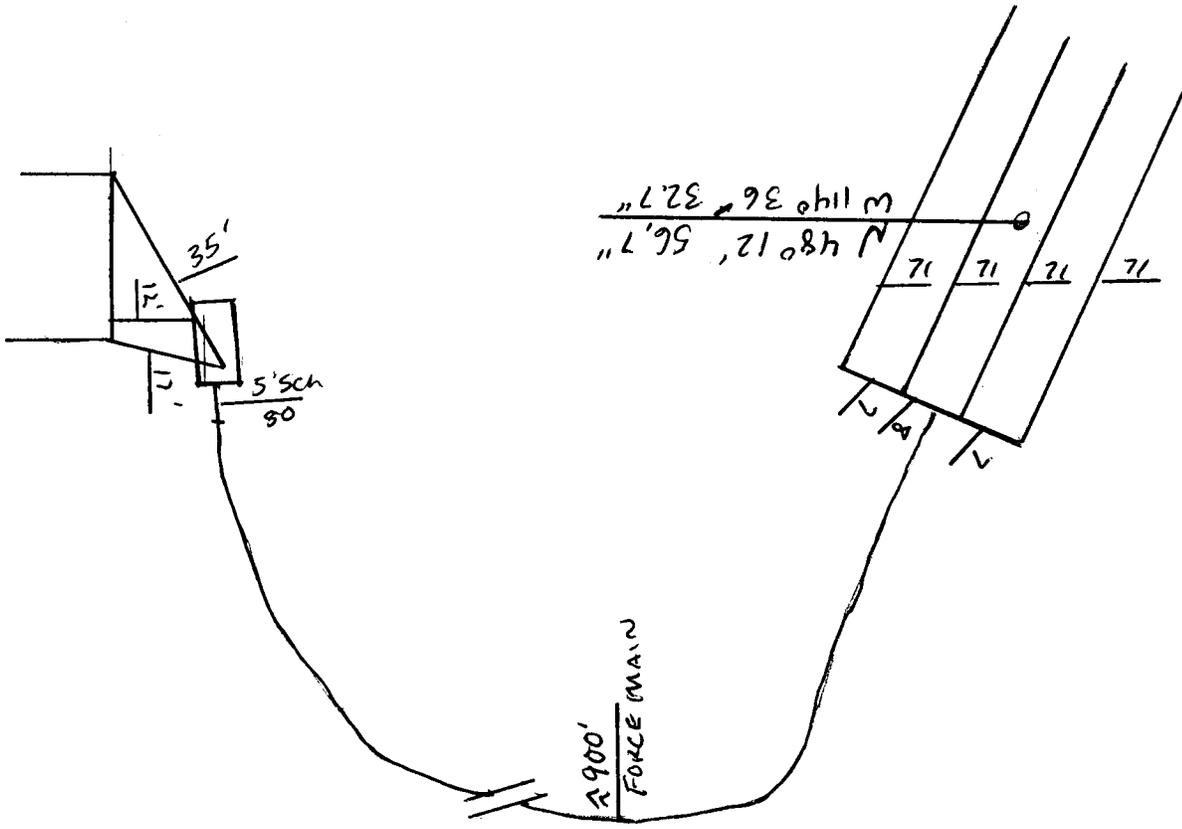

Water source developed at time of inspection? YES  NO

Distribution YES  NO

Disapproved /Date \_\_\_\_\_ Comments \_\_\_\_\_

Approved /Date 25 APR 07 Comments 1500/500 gal tank, 5' sch from tank, DRAWFIELD orientated NW-SE, OVER 70' minimum trench length, over 281 lined feet in 3' wide gravelless chamber, over 5' pump test.

Inspector's Signature [Signature] Name of Installer Lee Schlegel 755-7648